

# Monitoring Indoor Environmental Quality Changes in a Classroom: A Case Study



Bernard Polednik<sup>1\*</sup> , Łukasz Guz<sup>1</sup> , Adam Piotrowicz<sup>1</sup>  and Anna Badora<sup>1</sup> 

<sup>1</sup>Faculty of Environmental Engineering and Energy, Lublin University of Technology (LUT), ul. Nadbystrzycka 40B, 20-618 Lublin, Poland

## Abstract:

**Introduction:** Indoor environmental quality (IEQ) is particularly important in classrooms, as students spend a significant portion of their time there. This study analyzes the variability of IEQ in a naturally ventilated classroom during the heating season. It assesses environmental quality using a newly developed 10-point IEQI index that integrates indoor air pollutant concentrations and thermal conditions.

**Methods:** Low-cost sensors were applied to continuously monitor typical indoor air pollutant concentrations and thermal condition parameters. The obtained results were used to calculate the Indoor Air Quality Index (IAQI) and the Thermal Condition Index (TCI), which served as the basis for determining the overall IEQ Index (IEQI). Variations in the IEQI were analyzed during periods of student occupancy, during the night, and throughout the entire monitoring period.

**Results:** When students were present in the classroom, pollutant concentrations, particularly CO<sub>2</sub>, increased significantly, with maximum values often exceeding 3300 ppm. Air temperature rose above 24°C. The calculated IAQI, TCI, and IEQI values were sensitive to occupancy fluctuations and varied throughout the day. IEQI values sometimes exceeded level 5, indicating relatively poor environmental quality at these times.

**Discussion:** The findings are consistent with previous studies that indicate that student presence negatively affects indoor environmental conditions in classrooms. The proposed IEQI, reflecting the dynamic interplay of occupancy, air pollution, and thermal conditions, allows for a relatively simple and ongoing assessment of environmental quality in classrooms. To fully evaluate its reliability, interpretability, and practical value, subjective validation of the IEQI is recommended.

**Conclusion:** Student presence significantly contributes to the deterioration of IEQ in the classroom. The proposed IEQI is a promising tool for monitoring and improving indoor environmental conditions not only in the studied classroom but also in similar spaces. By accounting for all relevant environmental parameters and conducting appropriate validation, this index can support the optimization of HVAC systems and the implementation of intelligent indoor environmental control strategies, thereby ensuring healthier, more comfortable conditions for students in classrooms.

**Keywords:** Classroom, low-cost sensors, Real-time monitoring, Indoor air quality, Thermal conditions, Indoor environmental quality index.

© 2026 The Author(s). Published by Bentham Open.

This is an open access article distributed under the terms of the Creative Commons Attribution 4.0 International Public License (CC-BY 4.0), a copy of which is available at: <https://creativecommons.org/licenses/by/4.0/legalcode>. This license permits unrestricted use, distribution, and reproduction in any medium, provided the original author and source are credited.

\*Address correspondence to this author at the Faculty of Environmental Engineering and Energy, Lublin University of Technology (LUT), ul. Nadbystrzycka 40B, 20-618 Lublin, Poland; E-mail: b.polednik@pollub.pl

Cite as: Polednik B, Guz Ł, Piotrowicz A, Badora A. Monitoring Indoor Environmental Quality Changes in a Classroom: A Case Study. Open Environ Res J. 2026; 19: e25902776434397. <http://dx.doi.org/10.2174/012590277643439726021112408>



CrossMark

Received: August 25, 2025  
Revised: November 19, 2025  
Accepted: December 31, 2025  
Published: ?? ??, 2026



Send Orders for Reprints to  
[reprints@benthamscience.net](mailto:reprints@benthamscience.net)

## 1. INTRODUCTION

Indoor environmental quality (IEQ) defines the overall environmental conditions inside a building and is mainly affected by Indoor Air Quality (IAQ) and Thermal Conditions (TC). Other factors influencing IEQ include building architecture, lighting, acoustics, and HVAC system performance (CEN EN 16798, 2019). IAQ and TC have the greatest impact on human health, well-being, and cognitive performance. IAQ is most often assessed by measuring the concentrations of indoor air pollutants such as Particulate Matter (PM), Carbon Dioxide (CO<sub>2</sub>), Volatile Organic Compounds (VOCs), formaldehyde (CH<sub>2</sub>O), as well as biological agents (BLF, 2023). Elevated levels of those pollutants can adversely affect human health, especially given that people spend the majority of their time indoors. TC are typically described by physical parameters such as air Temperature (T), Relative Humidity (RH), and airflow velocity, which determine heat exchange between the human body and the surrounding environment (ISO 7730, 2005).

In most countries, people spend over 80% of their time indoors (van Grieken *et al.*, 2024). The rise of remote work and online learning further increases the need to maintain a healthy indoor environment (Young *et al.*, 2024). Poor IEQ has been associated with increased health risks, reduced productivity, and impaired learning performance (Liu *et al.*, 2024; Mujan *et al.*, 2019; Dimitroulopoulou *et al.*, 2023; Fissore *et al.*, 2023). This issue is particularly important in schools where children and adolescents spend considerable amounts of their time (Sadriazadeh *et al.*, 2022; Wargocki *et al.*, 2020). However, there are no specific regulatory standards for IEQ in schools; therefore, general exposure guidelines are often followed. The World Health Organization (WHO) provides a guideline for some indoor air pollutants. For CH<sub>2</sub>O, the recommended short-term exposure is below 0.1 mg/m<sup>3</sup> (WHO, 2010). Values for other common pollutants are mainly based on established building guidelines and standards (*e.g.*, CO<sub>2</sub> < 1000 ppm, PM<sub>2.5</sub> < 10 µg/m<sup>3</sup>, PM<sub>10</sub> < 25 µg/m<sup>3</sup>, total VOCs < 200 µg/m<sup>3</sup>) (Dimitroulopoulou *et al.*, 2023). Indoor air temperature (20–26°C) and relative humidity (30–60%) should be maintained at levels consistent with comfort requirements and indoor thermal environment standards (CEN EN 16798, 2019; ISO 7730, 2005).

Environmental monitoring in schools mainly focuses on IAQ and TC in classrooms, as these significantly affect students' health, comfort, and cognitive performance. It provides key data for designing strategies to mitigate the impact of poor indoor conditions and improve the classroom environments, both for students and teachers.

Various IAQ and IEQ indexes have been developed aimed at simplifying the assessment. These indices vary in the number and types of included parameters, scaling methods, and interpretative formats. Some are based solely on pollutant concentrations (Wong *et al.*, 2007; Wang *et al.*, 2008; Mainka and Zajusz-Zubek, 2015; Wang *et al.*, 2016; Koufi *et al.*, 2017), other include thermal parameters (ISO 7730, 2005; Burek *et al.*, 2006; Pereira *et al.*, 2014; Li *et al.*, 2016; Piasecki and Kostyrko, 2020), and some combine physical indicators with subjective assessments of comfort or health effects (Li *et al.*, 2016; Sarbu and Sebarchievici, 2013). Further examples include indexes based on measurements of multiple pollutants in air-conditioned offices (Wong *et al.*, 2007), adaptations of outdoor air quality index formulas for indoor use (Wang *et al.*, 2008; US EPA, 2016), or comprehensive indicators that take into account temperature, noise, lighting, and user satisfaction (Li *et al.*, 2016; Piasecki and Kostyrko, 2020; Sun *et al.*, 2022).

To date, there is no widely accepted IEQ index for classroom environments - one that balances scientific validity with practical applicability. A suitable index should reflect both health-related risks and environmental comfort, while supporting operational decision-making in school buildings.

The main objective of this study is to present the variability of IEQ in a naturally ventilated classroom during the heating season and to evaluate it using a newly developed 10-point IEQ index, which integrates indoor air pollutant concentrations and thermal conditions. Additionally, the study aims to show the variations of the IEQ index when students are present in the classroom and at other defined monitoring periods.

The main objective of this study is to present the variability of IEQ in a naturally ventilated classroom during the heating season and to evaluate it using a newly developed 10-point IEQ index, which integrates indoor air pollutant concentrations and thermal conditions. Additionally, the study aims to show the variations of the IEQ index when students are present in the classroom and at other defined monitoring periods.

## 2. METHODS

### 2.1. Study Site and Measurement Protocol

Measurements of indoor air pollutant concentrations and parameters influencing thermal conditions were conducted over a three-week period during the 2023/2024 heating season in one of the classrooms at the Lublin University of Technology, located in eastern Poland. The selected classroom was a rectangular room with a volume of 86 m<sup>3</sup>, and was located on the third floor of one of the university buildings (Fig. 1). The room was naturally ventilated and heated by two panel radiators connected to a heat exchanger. Each radiator was equipped with a thermostatic valve set to maintain an indoor temperature of 20°C.

Regular classes with students were held in accordance with the university's weekly schedule, from Monday to Saturday, typically from 9:00 a.m. to 4:00 p.m. Each class lasted approximately 90 minutes and was followed by a 15-minute break. Each session involved 8 to 16 students, who were evenly distributed throughout the classroom.

### 2.2. Instrumentation and Data Acquisition

Measurements were carried out using a set of calibrated low-cost sensors placed in the central part of the room, 1.1 m above the floor. These sensors continuously measured and recorded, at 1-minute intervals, the concentrations of CO<sub>2</sub>, PM<sub>2.5</sub>, PM<sub>10</sub>, CH<sub>2</sub>O, and VOCs (expressed as total concentration in isobutylene equivalents), as well as indoor air Temperature (T), Relative Humidity (RH), and atmospheric Pressure (p). Technical specifications provided by the sensor manufacturers are summarized in Table 1. Additional air


pollutants, such as nitrogen dioxide (NO<sub>2</sub>) and sulfur dioxide (SO<sub>2</sub>), were also monitored in the classroom but were excluded from the analysis presented in this study due to their relatively low concentrations and limited variability while students were present in the room. An indoor air microbiological analysis was also performed using impactor-based sampling; however, its results are not included in this study to maintain a focused scope.

### 2.3. Development and Calculation of the IEQ Index

The Indoor Environmental Quality Index (IEQI) was developed based on the measured concentrations of air pollutants affecting IAQ, together with data on air parameters affecting thermal conditions in the classroom.

It should be noted that the term IEQI is limited in scope, as it does not account for all factors that may influence the overall indoor environmental quality. The IEQI calculation involved several intermediate steps, including the determination of the Indoor Air Quality Index (IAQI) and the Thermal Condition Index (TCI). The IAQI calculation methodology was adapted from the U.S. Environmental Protection Agency (EPA) procedure used to determine the Outdoor Air Quality Index (AQI) (US EPA, 2016), with appropriate modifications for indoor applications. The IAQI value for each considered indoor air pollutant was obtained using a linear interpolation approach, according to (Eq. 1).

$$IAQI = (C - C_l)(I_h - I_l)/(C_h - C_l) + I_l \quad (1)$$

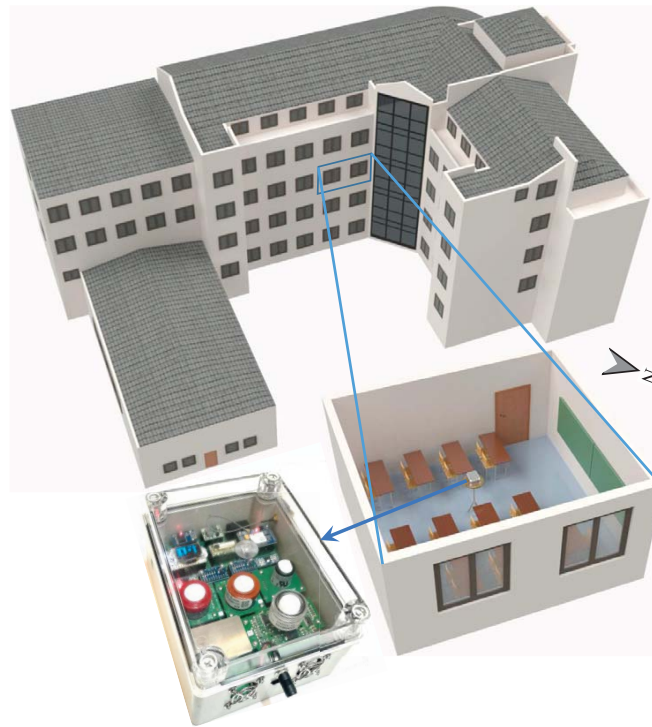

**Fig. (1).** Schematic view of the university building with the monitored classroom, and a photo of the sensor setup used in the study.

**Table 1. Technical specifications of the low-cost sensors used in the study.**

Parameter	Measurement Range	Accuracy	Resolution	Sensor Model
CO <sub>2</sub>	300-5000 ppm	±50 ppm + 3% of reading	1 ppm	Figaro CDM7160
PM <sub>2.5</sub> / PM <sub>10</sub>	0-500 µg/m <sup>3</sup>	±10 µg/m <sup>3</sup> (0-100 µg/m <sup>3</sup> ); ±10% of reading (100-500 µg/m <sup>3</sup> )	1 µg/m <sup>3</sup>	Plantower PMS5003
CH <sub>2</sub> O	0-10 ppm	±0.1 ppm	0.01 ppm	Mambrapor CH2O-C-10
VOCs	0-50 ppm	±3% of reading	1 ppb	Alphasense PID-AH2
Temperature (T)	-40 to +85°C	±0.5°C (0-65°C); ±1.25°C (-20 to 0°C); ±1.5°C (-40 to -20°C)	0.01°C	Bosch BME280
Relative humidity (RH)	0-100%	±3% (20-80%)	0.008%	Bosch BME280
Pressure (p)	300-1250 hPa	±1.0 hPa (300-1100 hPa, -20 to 0°C); ±1.5 hPa (1100-1250 hPa, -20 to 0°C); ±1.7 hPa (300-1100 hPa, below -20°C)	0.18 Pa	Bosch BME280

where  $C$  is the pollutant concentration,  $C_h$  is the concentration breakpoint greater than or equal to  $C$ ,  $C_l$  is the concentration breakpoint less than or equal to  $C$ ,  $I_h$  is the index breakpoint corresponding to  $C_h$ , and  $I_l$  is the index breakpoint corresponding to  $C_l$ .

The IAQI calculation was based on the 1-minute average of continuous concentration measurements of the five considered pollutants. This approach was essential due to the rapid air quality fluctuations in the classroom. Pollutant concentrations were converted into IAQI values using a 10-point scale (0-10), which is considered more intuitive and practical than alternative scales. Pollutant concentration breakpoints, their corresponding IAQI values, and the assigned air quality categories are presented in Table 2. These categories are color-coded to reflect increasing levels of health risk and are classified as follows: Good (0-2), Moderate (2-4), Poor (4-6), Unhealthy (6-8), and Hazardous (8-10).

$$ACC = -k \cdot \ln(h/h_0) \quad (2)$$

where  $h$  is the specific enthalpy of indoor air, calculated from measured  $T$ ,  $RH$ , and  $p$  using standard psychrometric equations, and  $h_0$  is the threshold specific enthalpy neutral for perception (*i.e.*, when  $ACC = 0$ ). The values of the coefficient  $k$  and  $h_0$  are adopted from an empirical model (Burek *et al.*, 2006), and are dependent on the  $RH$  and the level of indoor air pollution.

ACC values ranging from  $-1$  (not acceptable air quality) to  $+1$  (acceptable air quality) were applied to determine the percentage of dissatisfied students (PD), calculated using (Eq. 3) (Burek *et al.*, 2017):

$$PD = 100 / (1 + \exp(3.15 ACC + 0.043)) \quad (3)$$

The PD values, calculated at 1-minute intervals, were divided by 10, and the results were adopted as the TCI. The TCI was also categorized on a 10-point scale, with 0 indicating very good quality and 10 indicating very poor quality.

As previously mentioned, the proposed IEQI combines the IAQI and TCI into a single index that can be determined using various calculation methods. This study considered four IEQI variants: the arithmetic mean (Mean IEQI), the root mean square (MS IEQI), the weighted mean (WM IEQI), and the average of the maximum IAQI and TCI values (Max IEQI). The individual IEQI values were calculated according to (Eqs. 4-9):

$$\text{Mean IEQI} = (\sum_{i=1}^n \text{IAQI}_i + \text{TCI}) / (n + 1) \quad (4)$$

$$\text{MS IEQI} = \sqrt{(\sum_{i=1}^n \text{IAQI}_i^2 + \text{TCI}^2) / (n + 1)} \quad (5)$$

$$\text{WM IEQI} = (\text{Mean IAQI} + \text{TCI}) / 2 \quad (6)$$

$$\text{Max IEQI} = (\text{Max IAQI} + \text{TCI}) / 2 \quad (7)$$

where:

$$\text{Mean IAQI} = \sum_{i=1}^n \text{IAQI}_i / n \quad (8)$$

$$\text{Max IAQI} = \max[\text{IAQI}_i] \quad (9)$$

and  $n$  is the number of considered pollutants.

### 3. RESULTS

#### 3.1. Indoor Air Pollution Levels and Thermal Conditions

Table 3 shows basic statistical information regarding  $\text{CO}_2$ ,  $\text{PM}_{2.5}$ ,  $\text{PM}_{10}$ ,  $\text{CH}_2\text{O}$ , and VOCs concentrations, as well as air temperature and relative humidity in the classroom, along with the correlation coefficients of these parameters during the entire measurement period, the presence of students, and nighttime hours (10:00 p.m. to 6:00 a.m.). Mean values and Standard Deviations (SD) are presented with two decimal places due to large sample sizes; sensor accuracies are provided in Table 1. Throughout the entire monitoring period, average PM and VOCs concentrations exceeded the values recommended in building guidelines and standards, which are typically  $10 \mu\text{g}/\text{m}^3$  for  $\text{PM}_{2.5}$ ,  $25 \mu\text{g}/\text{m}^3$  for  $\text{PM}_{10}$ , and  $0.062 \text{ ppm}$  for VOCs (Dimitroulopoulou *et al.*, 2023; van Grieken *et al.*, 2024). For  $\text{PM}_{2.5}$  and VOCs, the average concentrations were nearly three times higher than the recommendations. The average temperature and relative humidity were within the comfort ranges,  $20\text{--}24^\circ\text{C}$  and  $30\text{--}60\%$ , respectively (ISO 7730, 2005; Liu *et al.*, 2024). The results differed significantly during the measurement periods with the students present in the classroom. Exceedances were recorded not only for PM and VOCs concentrations but also for  $\text{CO}_2$  concentrations and temperature.  $\text{CO}_2$  concentrations often exceeded the maximum level of  $3300 \text{ ppm}$  detectable by the sensor used. During nighttime hours, exceedances occurred only for PM concentrations, which may have been related to the infiltration of polluted outdoor air. The local sources of aerosol particles were most likely exhaust fumes from solid fuel combustion in nearby private houses, which were responsible for this air pollution (Polednik, 2013). The presented correlation coefficients, significant at  $p < 0.001$ , show that in addition to their obvious values close to 1 for the related concentrations of  $\text{PM}_{2.5}$  and  $\text{PM}_{10}$  ( $\text{PM}_{2.5}$  is part of  $\text{PM}_{10}$ ), there were also positive correlation coefficients greater than 0.75 for temperature, relative humidity, and  $\text{CO}_2$  concentrations both during the presence of students and throughout the entire monitoring period. At nighttime, significantly high correlation coefficients ( $r > 0.92$ ) were observed between  $\text{CH}_2\text{O}$  and PM concentrations, which could be caused by infiltration of pollutants resulting from the combustion of solid fuels in nearby private houses.

**Table 2. Pollutant concentration breakpoints and their corresponding Indoor Air Quality Index (IAQI) values, along with color-coded health categories.**

CO <sub>2</sub> [ppm]	PM <sub>2.5</sub> [µg/m <sup>3</sup> ]	PM <sub>10</sub> [µg/m <sup>3</sup> ]	CH <sub>2</sub> O [ppb]	VOC [ppm]	IAQI Range	Color Code	Air Quality Category
0-400	0-10	0-15	0-30	0-0.05	0-1		Good
400-600	10-20	15-25	30-50	0.05-0.1	1-2		
600-1000	20-30	25-40	50-75	0.1-0.2	2-3		Moderate
1000-1500	30-40	40-55	75-110	0.2-0.3	3-4		
1500-2000	40-50	55-75	110-150	0.3-0.5	4-5		Poor
2000-2500	50-60	75-95	150-200	0.5-0.8	5-6		
2500-3000	60-80	95-120	200-300	0.8-1.3	6-7		Unhealthy
3000-4000	80-100	120-150	300-500	1.3-2.0	7-8		
4000-5000	100-150	150-200	500-800	2.0-3.0	8-9		Hazardous
>5000	>150	>200	>800	>3.0	9-10		

**Note:** When calculating the TCI, a logarithmic formula (2) for the Acceptability Of Air Quality (ACC) was used based on the Weber-Fechner Law:

**Table 3. Means, standard deviations, and correlation coefficients of the measured pollutant concentrations and thermal condition parameters.**

	Mean	SD	CO <sub>2</sub> [ppm]	PM <sub>2.5</sub> [µg/m <sup>3</sup> ]	PM <sub>10</sub> [µg/m <sup>3</sup> ]	CH <sub>2</sub> O [ppb]	VOC [ppm]	T [°C]	RH [%]
<b>Entire Monitoring n = 9558</b>									
CO <sub>2</sub> [ppm]	880.73	690.95	1.00	-0.18	-0.19	0.24	0.53	0.77	0.75
PM <sub>2.5</sub> [µg/m <sup>3</sup> ]	28.19	17.56	-0.18	1.00	0.995	0.22	-0.13	-0.34	-0.56
PM <sub>10</sub> [µg/m <sup>3</sup> ]	33.70	21.56	-0.19	0.995	1.00	0.22	-0.14	-0.35	-0.56
CH <sub>2</sub> O [ppb]	25.78	17.20	0.24	0.22	0.22	1.00	0.75	0.12	0.07
VOC [ppm]	0.17	0.14	0.53	-0.13	-0.14	0.75	1.00	0.44	0.38
T [°C]	23.20	0.99	0.77	-0.34	-0.35	0.12	0.44	1.00	0.56
RH [%]	31.50	5.00	0.75	-0.56	-0.56	0.07	0.38	0.56	1.00
<b>Student Presence n = 1896</b>									
CO <sub>2</sub> [ppm]	1962.2	802.60	1.00	-0.28	-0.29	0.17	0.36	0.89	0.87
PM <sub>2.5</sub> [µg/m <sup>3</sup> ]	24.24	14.66	-0.28	1.00	0.99	-0.08	-0.27	-0.49	-0.45
PM <sub>10</sub> [µg/m <sup>3</sup> ]	28.80	18.31	-0.29	0.99	1.00	-0.09	-0.28	-0.50	-0.44
CH <sub>2</sub> O [ppb]	34.56	21.84	0.17	-0.08	-0.09	1.00	0.82	0.18	0.08
VOC [ppm]	0.27	0.22	0.36	-0.27	-0.28	0.82	1.00	0.39	0.32
T [°C]	24.15	1.14	0.89	-0.49	-0.50	0.18	0.39	1.00	0.84
RH [%]	37.75	4.51	0.87	-0.45	-0.44	0.08	0.32	0.84	1.00
<b>Nighttime n = 4215</b>									
CO <sub>2</sub> [ppm]	514.53	25.88	1.00	0.33	0.29	0.24	0.78	0.52	-0.37
PM <sub>2.5</sub> [µg/m <sup>3</sup> ]	32.63	16.37	0.33	1.00	0.99	0.93	0.27	-0.26	-0.67
PM <sub>10</sub> [µg/m <sup>3</sup> ]	39.14	20.34	0.29	0.99	1.00	0.92	0.24	-0.28	-0.67
CH <sub>2</sub> O [ppb]	23.21	6.25	0.24	0.93	0.92	1.00	0.20	-0.23	-0.59
VOC [ppm]	0.12	0.01	0.78	0.27	0.24	0.20	1.00	0.56	-0.54
T [°C]	22.83	0.36	0.52	-0.26	-0.28	-0.23	0.56	1.00	-0.15
RH [%]	28.61	3.34	-0.37	-0.67	-0.67	-0.59	-0.54	-0.15	1.00

**Note:** n - number of measurements.

### 3.2. Indoor Air Quality and Thermal Condition Indexes


Figure 2 shows the time series of the IAQI calculated from (Eq. 1) using the measured concentrations of CO<sub>2</sub>, PM<sub>2.5</sub>, PM<sub>10</sub>, CH<sub>2</sub>O, and VOCs, as well as the time series of TCI calculated from (Eqs. 2, 3) based on temperature and relative humidity in the classroom during monitoring.

Periods when the classroom was occupied by students (O) and nighttime hours (N) are indicated. The graphs show that once the students entered the classroom, the IAQI, calculated based on CO<sub>2</sub>, CH<sub>2</sub>O, and VOCs concentrations, rapidly increased above level 5. On the other hand, values of IAQI calculated based on PM concentrations underwent only slight changes. They generally showed high values before the classes and then decreased to medium (~ 3) or

even low levels ( $< 1$ ). However, during nighttime monitoring, the indices occasionally exceeded 5. This can be explained by the predominance of filtration of inhaled aerosol particles and their deposition in students' lungs over the processes that generate and introduce these particles into the air in the classroom (Polednik, 2013). As for the changes in TCI, during the presence of students in the classroom, it increased from low ( $\sim 1$ -2) to medium ( $\sim 4$ ). It should be noted that TCI values are always greater than 0, as the percentage of students dissatisfied with

thermal conditions never equals 0, even under ideal conditions.

Statistical data corresponding to the graphs in Fig. (2) are summarized in Table 4. It includes the mean values, standard deviations, and correlation coefficients for IAQI associated with individual pollutants and for TCI throughout the entire monitored period, as well as separately for periods of student presence and nighttime hours.

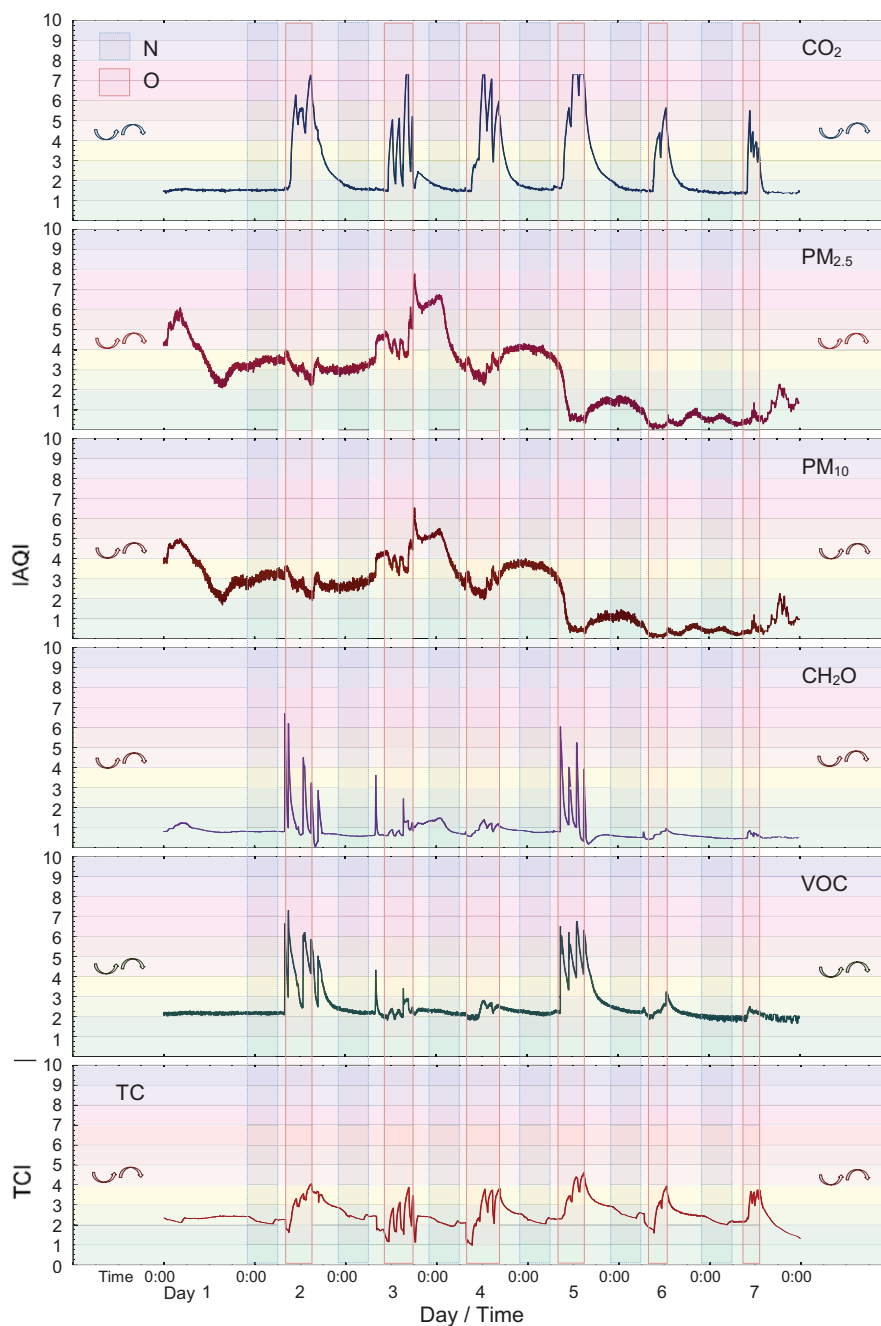

**Fig. (2).** Time series of the Indoor Air Quality Indexes for individual pollutants (IAQI) and the Thermal Condition Index (TCI) in the classroom. N - nighttime, O - occupied by students.

**Table 4. Mean values, standard deviations, and correlation coefficients of the Indoor Air Quality Indexes for individual pollutants (IAQI) and the Thermal Condition Index (TCI) in the classroom.**

IAQI	Mean	SD	CO <sub>2</sub>	PM <sub>2.5</sub>	PM <sub>10</sub>	CH <sub>2</sub> O	VOC	TCI
<b>Entire Monitoring n = 9557</b>								
CO <sub>2</sub>	2.44	1.53	1.00	-0.17	-0.17	0.28	0.62	0.84
PM <sub>2.5</sub>	2.80	1.70	-0.17	1.00	0.99	0.22	-0.13	-0.34
PM <sub>10</sub>	2.44	1.51	-0.17	0.99	1.00	0.22	-0.13	-0.35
CH <sub>2</sub> O	0.88	0.60	0.28	0.22	0.22	1.00	0.70	0.16
VOC	2.52	0.87	0.62	-0.13	-0.13	0.70	1.00	0.57
TCI	2.55	0.58	0.84	-0.34	-0.35	0.16	0.57	1.00
<b>Student Presence n = 1895</b>								
CO <sub>2</sub>	4.87	1.58	1.00	-0.28	-0.28	0.16	0.43	0.90
PM <sub>2.5</sub>	2.42	1.47	-0.28	1.00	1.00	-0.08	-0.28	-0.50
PM <sub>10</sub>	2.14	1.34	-0.28	1.00	1.00	-0.09	-0.28	-0.50
CH <sub>2</sub> O	1.23	0.84	0.16	-0.08	-0.09	1.00	0.75	0.17
VOC	3.28	1.32	0.43	-0.28	-0.28	0.75	1.00	0.48
TCI	3.15	0.71	0.90	-0.50	-0.50	0.17	0.48	1.00
<b>Nighttime n = 4215</b>								
CO <sub>2</sub>	1.57	0.13	1.00	0.33	0.28	0.27	0.77	0.54
PM <sub>2.5</sub>	3.24	1.58	0.33	1.00	0.99	0.91	0.30	-0.27
PM <sub>10</sub>	2.82	1.39	0.28	0.99	1.00	0.88	0.27	-0.28
CH <sub>2</sub> O	0.78	0.23	0.27	0.91	0.88	1.00	0.23	-0.24
VOC	2.18	0.12	0.77	0.30	0.27	0.23	1.00	0.56
TCI	2.31	0.20	0.54	-0.27	-0.28	-0.24	0.56	1.00

Note: n - number of measurements.

### 3.3. Indoor Environmental Quality

The summary shows that the highest average IAQI values for CO<sub>2</sub>, CH<sub>2</sub>O, and VOCs, as well as the highest average TCI values, were obtained when students were present in the classroom. In contrast, the highest average IAQI values for PM were recorded during nighttime hours. At that time, IAQI values for CH<sub>2</sub>O, PM<sub>2.5</sub>, and PM<sub>10</sub> exhibited strong correlations ( $r > 0.88$ ). Throughout the entire monitoring period and during the student presence, positive correlation coefficients greater than 0.84 were observed between IAQI for CO<sub>2</sub> and TCI values.

The time series of Mean IAQI, Max IAQI, Mean IEQI, MS IEQI, WM IEQI, and Max IEQI are presented in Fig. (3). It is evident that the highest values for both the mean and maximum IAQI and IEQI occurred during the student presence, while the lowest values were recorded during nighttime hours. When students were present, Max IAQI and Max IEQI sometimes exceeded levels 7 and 5, respectively, indicating episodes of seemingly poor air quality and environmental conditions in the classroom. During nighttime hours, the average values of these indexes remained around 3. Even though such values are relatively low, they may still be concerning as they can result from external air pollution and pollutant infiltration into the classroom, or suboptimal operation of the heating system.

## 4. DISCUSSION

### 4.1. Interpretation of Findings and Practical Applications

Our study supports and extends the previous findings, indicating that the presence of students adversely affects indoor comfort in classrooms. It is mainly associated with elevated concentrations of CO<sub>2</sub> emitted by students, along with other pollutants linked to their presence (Baloch *et al.*, 2020; Maciejewska and Szczurek, 2025). In addition, increases in temperature and humidity may also occur that further impact thermal conditions in classrooms (Pereira *et al.*, 2014).

As previously mentioned, IEQ is a complex and multifaceted concept influenced by various factors. Therefore, any attempt to represent IEQ using a single aggregate numerical measure should be approached with caution (Coulby *et al.*, 2014; Riffelli, 2021; Pourkiaei and Romain, 2023). In light of this, the study proposes the utilization of two primary determinants of indoor comfort: air quality and thermal conditions. According to the European standard (CEN EN 16798, 2019), which defines requirements for indoor environmental parameters, visual and acoustic comfort are also of significance. However, these aspects were not considered in the present study, which focuses on air quality and thermal parameters. It should be noted that there is no consensus among researchers regarding which factors should be taken into



The 10-point scale for IAQ, TC, and the IEQ indexes developed in this study is intuitive and easy to interpret, particularly when comparing values across different environmental conditions in the monitored classroom. Each averaging method considered in this study for calculating IEQI values offers distinct insights that are practically useful for indoor environment management. A rapid response to changes in classroom conditions could be facilitated by continuous monitoring of the proposed IEQI values, as it proved sensitive to variations in classroom occupancy. Such monitoring could also support decisions regarding heating and ventilation system upgrades or air conditioning implementation, thereby enhancing students' health and learning outcomes. In addition, this index could be applied to optimize indoor air treatment and improve the efficiency of ventilation or air conditioning control in the monitored classroom and similar indoor environments.

#### 4.2. Limitations and Directions for Future Research

The newly developed assessment index can reflect changes in classroom environmental quality, but it has several limitations affecting its reliability and accuracy. As mentioned earlier, it considers only IAQ and TC, omitting other important factors such as lighting and acoustics. This study was based on short-term measurements in a single classroom, serving as a preliminary demonstration rather than a fully validated methodology. The consistent increase of IEQI values when students were present in the classroom supports the reliability of the index; however, more thorough validation is needed. To enhance the IEQI's accuracy and usefulness, future research should compare it with established IEQ standards such as BREEAM (BRE Global, n.d.), WELL (International WELL Building Institute, 2020), and LEED (U.S. Green Building Council, n.d.), which consider a broader range of environmental factors. Incorporating surveys or questionnaires to gather students' subjective perceptions would also help validate and refine the index. Additionally, the application of statistical methods such as Principal Component Analysis (PCA), Canonical Correlation Analysis (CCA), or Structural Equation Modeling (SEM) could help identify key relationships between environmental factors and perceived comfort, allowing for better weighting and overall enhancement of the IEQI. Finally, considering the results and limitations of this study, we recommend: (1) developing a modular version of the IEQI that incorporates lighting and acoustic parameters, (2) testing its applicability in various school types and climatic regions, and (3) evaluating its potential for real-time integration with smart ventilation or HVAC systems. These steps would significantly enhance the index's usability and relevance in indoor environments.

#### CONCLUSION

Indoor environmental quality is negatively affected by student presence in the monitored classroom. The proposed 10-point IEQ index, which integrates indoor air pollutant concentrations and thermal condition parameters, is an objective tool for assessing

environmental quality in classrooms. The continuous monitoring performed in the study showed notable fluctuations in IEQ and demonstrated that student occupancy influences CO<sub>2</sub> levels, temperature, and relative humidity. When students were present in the classroom, IEQI values frequently exceeded level 5, indicating suboptimal conditions. Real-time tracking of the index could provide an opportunity to detect the deterioration of indoor environments at an early stage and support the implementation of timely corrective actions, including the optimization of HVAC system operation and application of intelligent indoor environment control strategies. Even though the index is currently limited to air quality and thermal conditions, it exhibits strong potential for adaptation, scalability, and broader application in similar indoor environments, provided that appropriate subjective validation is conducted. To sum up, the IEQI could offer a simple and effective method for assessing the quality of indoor school environments, promoting students' well-being, cognitive performance, and long-term health.

#### AUTHORS' CONTRIBUTIONS

The authors confirm their contribution to the paper as follows: B.P.: Study conception and design; L.G.: Data collection; A.P.: Writing - original draft preparation; A.B.: Writing - reviewing and editing. All authors reviewed the results and approved the final version of the manuscript.

#### LIST OF ABBREVIATIONS

WHO	=	World Health Organization
PM	=	Particulate Matter
IEQ	=	Indoor Environmental Quality
IEQI	=	Indoor Environmental Quality Index
IAQ	=	Indoor Air Quality
IAQI	=	Indoor Air Quality Index
TC	=	Thermal Condition
TCI	=	Thermal Condition Index
ACC	=	Acceptability of Air Quality
PD	=	Percentage of Dissatisfied

#### CONSENT FOR PUBLICATION

Not applicable.

#### AVAILABILITY OF DATA AND MATERIALS

The data supporting the findings of the article were obtained from field measurements conducted in a naturally ventilated classroom, designed and carried out by the authors. The dataset is available from the corresponding author [B.P.] upon reasonable request.

#### FUNDING

None.

#### CONFLICT OF INTEREST

The authors declare no conflict of interest, financial or otherwise.

## ACKNOWLEDGEMENTS

The authors would like to thank Lublin University of Technology, Poland for providing access to the classroom and Dr. Sławomira Dumala for assistance with the measurements.

## REFERENCES

- Baloch, RM, Maesano, CN, Christoffersen, J, Banerjee, S, Gabriel, M, Csobod, É, de Oliveira Fernandes, E, Annesi-Maesano, I, Csobod, É, Szuppinger, P, Prokai, R, Farkas, P, Fuzi, C, Cani, E, Draganic, J, Mogyorosy, ER, Korac, Z, de Oliveira Fernandes, E, Ventura, G, Madureira, J, Paciência, I, Martins, A, Pereira, R, Ramos, E, Rudnai, P, Páldy, A, Dura, G, Beregszászi, T, Vaskövi, É, Magyar, D, Pándics, T, Remény-Nagy, Z, Szentmihályi, R, Udvardy, O, Varró, MJ, Kephelopoulos, S, Kotzias, D, Barrero-Moreno, J, Mehmeti, R, Vilic, A, Maestro, D, Moshammer, H, Strasser, G, Brigitte, P, Hohenblum, P, Goelen, E, Stranger, M, Spruy, M, Sidjimov, M, Hadjipanayis, A, Katsonouri-Sazeides, A, Demetriou, E, Kubinova, R, Kazmarová, H, Dlouha, B, Kotlík, B, Vabar, H, Ruut, J, Metus, M, Rand, K, Järviste, A, Nevalainen, A, Hyvarinen, A, Täubel, M, Järvi, K, Annesi-Maesano, I, Mandin, C, Berthineau, B, Moriske, H-J, Giacomini, M, Neumann, A, Bartzis, J, Kalimeri, K, Saraga, D, Santamouris, M, Assimakopoulos, MN, Assimakopoulos, V, Carrer, P, Cattaneo, A, Pulvirenti, S, Vercelli, F, Strangi, F, Omeri, E, Piazza, S, D'Alcamo, A, Fanetti, AC, Sestini, P, Kouri, M, Viegi, G, Sarno, G, Baldacci, S, Maio, S, Cerrai, S, Franzitta, V, Bucchieri, S, Cibella, F, Simoni, M, Neri, M, Martuzevičius, D, Krugly, E, Montefort, S, Fsadni, P, Brewczyński, PZ, Krakowiak, E, Kurek, J, Kubarek, E, Wlazło, A, Borrego, C, Alves, C, Valente, J, Gurzau, E, Rosu, C, Popita, G, Neamtiu, I, Neagu, C, Norback, D, Bluysen, P, Bohms, M, Van Den Hazel, P, Cassee, F, de Bruin, YB, Bartonova, A, Yang, A, Halzlová, K, Jajcaj, M, Kániková, M, Miklankova, O, Vítkivá, M, Jovasević-Stojanovic, M, Zivkovic, M, Stevanovic, Z, Lazovic, I, Stevanovic, Z, Zivkovic, Z, Cerovic, S, Jovic-Stojanovic, J, Mumovic, D, Tarttelin, P, Chatzidiakou, L, Chatzidiakou, E & Dewolf, M-C (2020) Indoor air pollution, physical and comfort parameters related to schoolchildren's health: Data from the European SINPHONIE study. *Science of the Total Environment*, 739, 139870. [http://dx.doi.org/10.1016/j.scitotenv.2020.139870] [PMID: 32544681]
- Bhandari, N, Tadepalli, S & Gopalakrishnan, P (2024) Investigation of acoustic comfort, productivity, and engagement in naturally ventilated university classrooms: Role of background noise and students' noise sensitivity. *Building and Environment*, 249, 111131. [http://dx.doi.org/10.1016/j.buildenv.2023.111131]
- Burek, R, Polednik, B & Raczkowski, A (2006) Study of the relationship between the perceived air quality and the specific enthalpy of air polluted by people. *Archives of Environmental Protection*, 32, 21-6.
- Burek, R, Polednik, B & Guz, Ł (2017) Is the perception of clean, humid air indeed affected by cooling the respiratory tract? *AIP Conference Proceedings*, 1866, 040007. [http://dx.doi.org/10.1063/1.4994487]
- BREEAM: The world's leading science-based suite of validation and certification systems for a sustainable built environment. Available from: <https://www.breeam.com>
- Air pollution and allergies at home. Available from: <https://www.asthmaandlung.org.uk/living-with/indoor-air-pollution/home#what-is-indoor-airpollution>
- CEN EN 16798 (2019) Energy performance of buildings—Ventilation of buildings—Part 1: Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics. Available from: <https://standards.iteh.ai/catalog/standards/cen/b4f68755-2204-4796-854a-56643dfcfe89/en-16798-1-2019?srsltid=mBOor7c4C4Pn4z-zoD5mVnIt69oP78Hjzx72wvGAuHHvxWz6QKyUjNj>
- Coulby, G, Clear, A, Jones, O & Godfrey, A (2020) A scoping review of technological approaches to environmental monitoring. *International Journal of Environmental Research and Public Health*, 17, 3995. [http://dx.doi.org/10.3390/ijerph17113995] [PMID: 32512865]
- Dimitroulopoulou, S, Dudzińska, MR, Gunnarsen, L, Hägerhed, L, Maula, H, Singh, R, Toyinbo, O & Haverinen-Shaughnessy, U (2023) Indoor air quality guidelines from across the world: An appraisal considering energy saving, health, productivity, and comfort. *Environment International*, 178, 108127. [http://dx.doi.org/10.1016/j.envint.2023.108127] [PMID: 37544267]
- Fissore, VI, Fasano, S, Puglisi, GE, Shtrepi, L & Astolfi, A (2023) Indoor environmental quality and comfort in offices: A review. *Buildings*, 13, 2490. [http://dx.doi.org/10.3390/buildings13102490]
- The WELL Building Standard. Available from: <https://www.wellcertified.com>
- ISO 7730: 2005 Ergonomics of the thermal environment — Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria. Available from: [http://www.iso.org/iso/catalogue\\_detail.htm?csnumber=39155](http://www.iso.org/iso/catalogue_detail.htm?csnumber=39155)
- Koufi, L, Younsi, Z, Cherif, Y, Naji, H & El Ganaoui, M (2017) A numerical study of indoor air quality in a ventilated room using different strategies of ventilation. *Mechanics of Materials*, 18, 221-9. [http://dx.doi.org/10.1051/meca/2016043]
- Li, N, Cui, H, Zhu, C, Zhang, X & Su, L (2016) Grey preference analysis of indoor environmental factors using sub-indexes based on Weber/Fechner's law and predicted mean vote. *Indoor and Built Environment*, 25, 1197-208. [http://dx.doi.org/10.1177/1420326X15592940]
- Liu, G, Chen, H, Yuan, Y & Song, C (2024) Indoor thermal environment and human health: A systematic review. *Renewable and Sustainable Energy Reviews*, 191, 114164. [http://dx.doi.org/10.1016/j.rser.2023.114164]
- Maciejewska, M & Szczurek, A (2025) Indoor air parameters in association with students' performance, rating of indoor conditions and well-being during classes. *Building and Environment*, 271, 112633.

- [<http://dx.doi.org/10.1016/j.buildenv.2025.112633>]
- Mainka, A & Zajusz-Zubek, E (2015) Indoor air quality in urban and rural preschools in Upper Silesia, Poland: Particulate matter and carbon dioxide. *International Journal of Environmental Research and Public Health*, 12, 7697-711. [<http://dx.doi.org/10.3390/ijerph120707697>] [PMID: 26184249]
- Makaremi, N, Yildirim, S, Morgan, GT, Touchie, MF, Jakubiec, JA & Robinson, JB (2024) Impact of classroom environment on student wellbeing in higher education: Review and future directions. *Building and Environment*, 265, 111958. [<http://dx.doi.org/10.1016/j.buildenv.2024.111958>]
- Meng, X & Zhang, M (2025) Effects of classroom design characteristics on children's physiological and psychological responses: A virtual reality experiment. *Building and Environment*, 267, 112274. [<http://dx.doi.org/10.1016/j.buildenv.2024.112274>]
- Mujan, I, Anđelković, AS, Munčan, V, Kljajić, M & Ružić, D (2019) Influence of indoor environmental quality on human health and productivity - A review. *Journal of Cleaner Production*, 217, 646-57. [<http://dx.doi.org/10.1016/j.jclepro.2019.01.307>]
- Dias Pereira, L, Raimondo, D, Corgnati, SP & Gameiro da Silva, M (2014) Assessment of indoor air quality and thermal comfort in Portuguese secondary classrooms: Methodology and results. *Building and Environment*, 81, 69-80. [<http://dx.doi.org/10.1016/j.buildenv.2014.06.008>]
- Piasecki, M & Kostyrko, K (2020) Development of weighting scheme for indoor air quality model using a multi-attribute decision making method. *Energies*, 13, 3120. [<http://dx.doi.org/10.3390/en13123120>]
- Polednik, B (2013) Particulate matter and student exposure in school classrooms in Lublin, Poland. *Environmental Research*, 120, 134-9. [<http://dx.doi.org/10.1016/j.envres.2012.09.006>] [PMID: 23058371]
- Pourkiaei, M & Romain, AC (2023) Scoping review of indoor air quality indexes: Characterization and applications. *Journal of Building Engineering*, 75, 106703. [<http://dx.doi.org/10.1016/j.jobe.2023.106703>]
- Riffelli, S (2021) Global comfort indices in indoor environments: A survey. *Sustainability*, 13, 12784. [<http://dx.doi.org/10.3390/su132212784>]
- Sadrizadeh, S, Yao, R, Yuan, F, Awbi, H, Bahnfleth, W, Bi, Y, Cao, G, Croitoru, C, de Dear, R, Haghighat, F, Kumar, P, Malayeri, M, Nasiri, F, Ruud, M, Sadeghian, P, Wargocki, P, Xiong, J, Yu, W & Li, B (2022) Indoor air quality and health in schools: A critical review for developing the roadmap for the future school environment. *Journal of Building Engineering*, 57, 104908. [<http://dx.doi.org/10.1016/j.jobe.2022.104908>]
- Sarbu, I & Sebarchievici, C (2013) Aspects of indoor environmental quality assessment in buildings. *Energy and Buildings*, 60, 410-9. [<http://dx.doi.org/10.1016/j.enbuild.2013.02.005>]
- Sun, C, Huang, X, Zhang, J, Lu, R, Su, C & Huang, C (2022) The new model for evaluating indoor air quality based on childhood allergic and respiratory diseases in Shanghai. *Building and Environment*, 207, 108410. [<http://dx.doi.org/10.1016/j.buildenv.2021.108410>]
- Technical assistance document for the reporting of daily air quality - the air quality index (AQI). Available from: <https://www.epa.gov/air-quality-index>
- Leadership in Energy and Environmental Design (LEED). Available from: <https://www.usgbc.org/leed>
- van Grieken, A, de Leede, SC & Ye, L (2024) Indoor Air Quality and health of older people: A pilot study. *European Journal of Public Health*, 34 (Suppl. 3), ckae144.798. [<http://dx.doi.org/10.1093/eurpub/ckae144.798>]
- Wang, H, Tseng, C & Hsieh, T Developing an indoor air quality index system based on the health risk assessment. *Indoor Air*. Copenhagen, Denmark, 17-22 August 2008.
- Wang, Y, Cao, Y, Liu, B, Liu, J, Yang, Y & Yu, Q (2016) An evaluation index for the control effect of the local ventilation systems on indoor air quality in industrial buildings. *Building Simulation*, 9, 669-76. [<http://dx.doi.org/10.1007/s12273-016-0295-2>]
- Wargocki, P, Porras-Salazar, JA, Contreras-Espinoza, S & Bahnfleth, W (2020) The relationships between classroom air quality and children's performance in school. *Building and Environment*, 173, 106749. [<http://dx.doi.org/10.1016/j.buildenv.2020.106749>]
- Wong, LT, Mui, KW & Hui, PS (2007) Screening for indoor air quality of air-conditioned offices. *Indoor and Built Environment*, 16, 438-43. [<http://dx.doi.org/10.1177/1420326X07082159>]
- WHO guidelines for indoor air quality: Selected pollutants. Available from: <https://www.who.int/publications/i/item/9789289002134>
- Young, AS, Parikh, S, Dedesko, S, Bliss, M, Xu, J, Zanolletti, A, Miller, SL & Allen, JG (2024) Home indoor air quality and cognitive function over one year for people working remotely during COVID-19. *Building and Environment*, 257, 111551. [<http://dx.doi.org/10.1016/j.buildenv.2024.111551>] [PMID: 38966206]